



OVERLOAD REPLACEMENT CHART

HP	208V	230V	480V
20HP	62A	54A	27A

CIRCUIT BREAKER CHART

208V/60Hz/3PH/120A CIRCUIT BREAKER
230V/60Hz/3PH/100A CIRCUIT BREAKER
480V/60Hz/3PH/60A CIRCUIT BREAKER

CUSTOMER TO SUPPLY AND INSTALL INCOMING SERVICE DISCONNECT AND BRANCH CIRCUIT OVERCURRENT PROTECTION IN ACCORDANCE WITH CURRENT EDITION OF N.E.C. (SEE THE CIRCUIT BREAKER CHART)

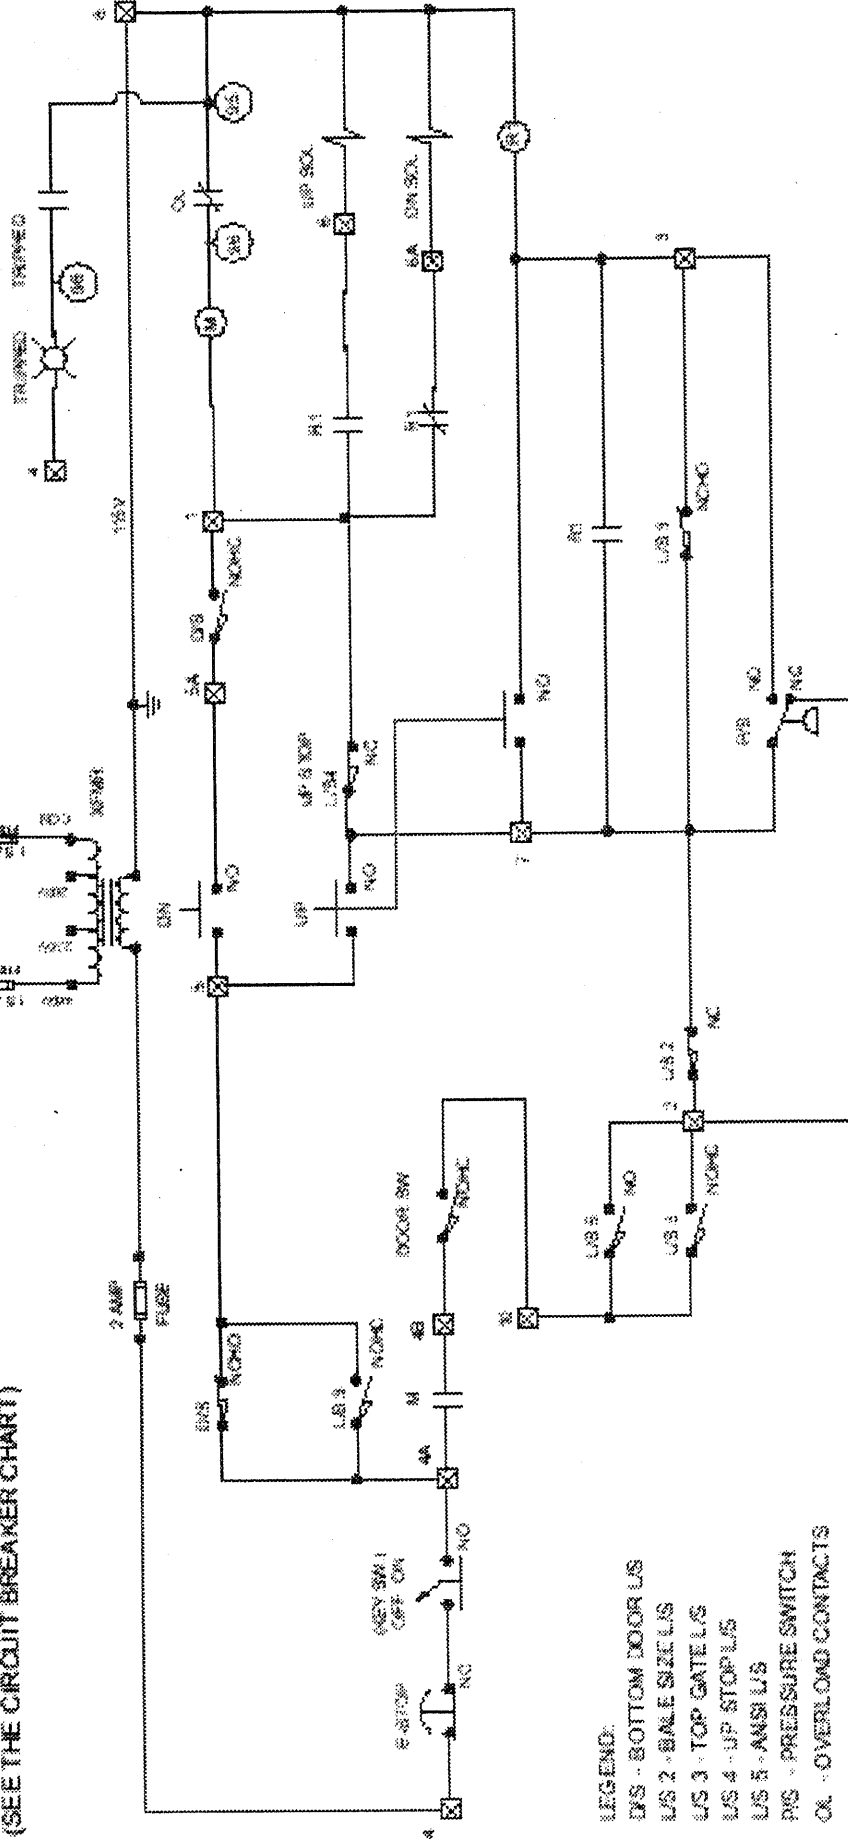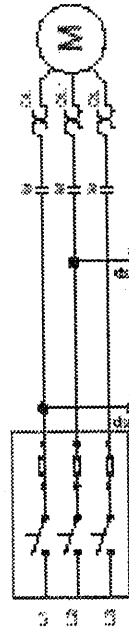

HYDROLEC Inc.
5100 S. Main Ave.
JACKSONVILLE, FL 32218
Phone (904) 730-3700
Fax (904) 730-3770



REVISIONS
DATE DESCRIPTION
HE20158-09
DATE
BY

FILE
ELECTRIC SCHEMATIC
DATE
BY

DATE
BY

DATE
BY